

Oil Wet Ramp Slip Resistance Test Certificate

Wednesday March 06th, 2019

Supplier: Australian Select Timber (61-63 Discovery Road, Dandenong, VIC, 3175, Australia)


Sample Description: Nouvelle Hybrid Rigid Flooring Board

Date Tested: March 2019 (Tested by FORAY Laboratories – NATA Accreditation 1231)

Test Method: AS/NZS 4586:2013 Appendix D “Slip resistance classification of new pedestrian surface materials – Oil Wet Inclining Platform Test Method” using Leipzig V73-SP shoes.

Test Data:

Sample Identification	Corrected mean overall acceptance angle result	Classification: Slip Resistance Assessment Group
Nouvelle Hybrid Rigid Flooring Board	10°	R10

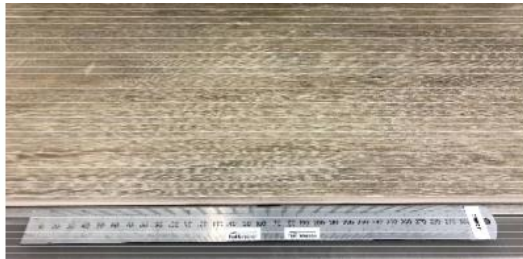


Dr. Vyt Garnys
PhD, BSc(Hons) AIMM, ARACI, ISIAQ
ACA, AIRAH, FMA
Managing Director and Principal Consultant



Nick Joy
BSc(Hons)
Consultant



Tuan Duong
B. Eng. (Chemical)
Consultant

CV190201