

Oil Wet Ramp Slip Resistance Test Certificate

Monday, 23rd November 2020

Supplier: Terra Mater Hardwood Floors Pty Ltd (PO BOX 731, Heathmont, VIC, 3135, Australia)


Sample Description: SPC Vinyl Plank

Date Tested: 18 November 2020 (Tested through FORAY Laboratories – NATA Accreditation 1231)

Test Method: AS/NZS 4586:2013 Appendix D “Slip resistance classification of new pedestrian surface materials – Oil Wet Inclining Platform Test Method” using Leipzig V73-SP shoes.

Test Data:

Sample Identification	Corrected mean overall acceptance angle result	Slip resistance Classification AS 4586:2013
SPC Vinyl Plank	9°	R9

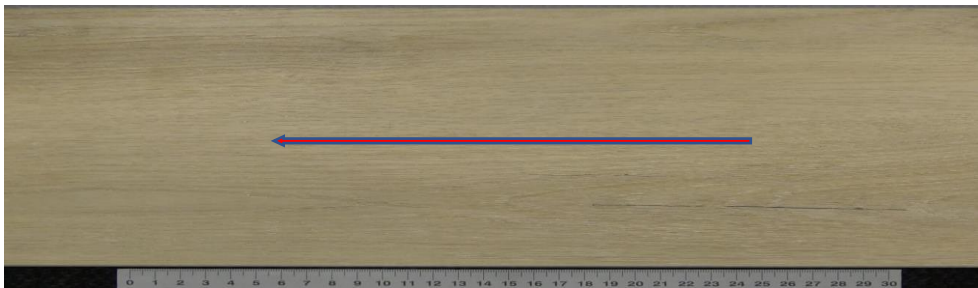

Arrow indicates direction of testing



Dr. Vyt Garnys
PhD, BSc (Hons) AIMM, ARACI, ISIAQ
ACA, AIRAH, FMA
Managing Director and Principal Consultant



Travis Hale
BSc (Biotechnology)
Consultant



Tuan Duong
B. Eng. (Chemical)
Consultant

V2011038