## AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

## **TEST REPORT**

Test Number:

Issue Date

**Print Date** 

24-002533

22/07/2024

25/07/2024

Client: Paxwood Pty Ltd T/A Clever Choice Design Floors

Unit 1

**Sample Description** 

164 Adderlely Street

West Auburn NSW 2144


Clients Ref : "Clever 9mm Hybrid Chevron"

Hybrid Planks

Nominal Composition: WPC Core/PVC

Nominal Mass per Unit Area/Density: 2100Kg/m3

Nominal Thickness: 9mm

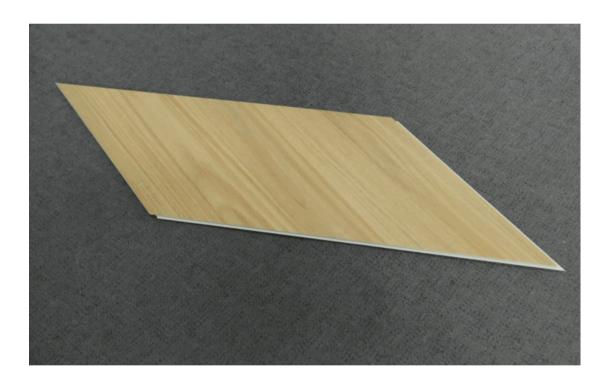

327075 71720 Page 1 of 2


Australian Wool Testing Authority Ltd Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.





## AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

## **TEST REPORT**

Client: Paxwood Pty Ltd T/A Clever Choice Design Floors

Unit 1

164 Adderlely Street

West Auburn NSW 2144

**Test Number** : 24-002533 **Issue Date** : 22/07/2024

22/07/2024 25/07/2024

AS ISO 9239.1-2003

Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a Radiant Heat Source

Date of Sample Arrival

17-07-2024

**Print Date** 

**Date Tested** 

22-07-2024

CHF Value Non Directional 2 8.9 3 8.9 Mean 8.8 kW/m²

Smoke Value

8.7

8.9

,

Non Directional

1 200 2 166 3 183 Mean

183 %.min

Observations:

Melting Blistering Yes

Yes

Each specimen was clamped to a substrate of 6mm thick fibre reinforced cement board prior to testing

No directional properties, three specimens tested only.

HF30 not reported as flame out time occurred before 30 minutes.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2010 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

Results in accordance with section 8.4 have not been included in the report. They are available upon request.

327075

71720

Page 2 of 2



Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

AlDela.

MICHAEL A. JACKSON B.Sc.(Hons)

Fiona McDonald